

UNIVERSITY OF CALIFORNIA, SANTA BARBARA

BERKELEY • DAVIS • IRVINE • LOS ANGELES • MERCED • RIVERSIDE • SAN DIEGO • SAN FRANCISCO



SANTA BARBARA • SANTA CRUZ

OFFICE OF DESIGN & CONSTRUCTION SERVICES and PHYSICAL FACILITIES

CONTRACTING SERVICES
Building 439
Santa Barbara, California 93106-1030
Telephone (805) 893-3356
Fax (805) 893-8592

SENT VIA: FAX ON THIS DATE
 EMAIL (IF PROVIDED) ON THIS DATE
 FEDERAL EXPRESS ON THIS DATE
 UNITED PARCEL SERVICE ON THIS DATE

HOLDERS OF PLANS AND SPECIFICATIONS:

Ortega and Santa Catalina Dinning Commons
Boiler Replacement, Bldgs. 542 & 860
Project No. FM120316S/137-53/139-52
Addendum No. 4


May 10, 2012

Enclosed is **ADDENDUM NO. 4** to the Construction Documents on the above-captioned project.

The Bid date is hereby changed from Thursday, May 10, 2012 to **Wednesday, May 16, 2012 at 2:30PM** to be held at:

CONTRACTING SERVICES
Facilities Management, Bldg. 439
Door #E, Reception Counter
University of California, Santa Barbara
Santa Barbara, CA 93106-1030

Late arrivals shall be disqualified. Please allow time for unforeseen traffic delays, securing a parking permit and potential parking problems.

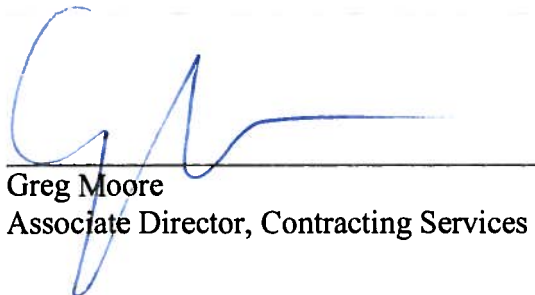

Greg Moore
Associate Director, Contracting Services

ADDENDUM NO. 4

to the

CONSTRUCTION DOCUMENTS

MAY 10, 2012

GENERAL

The following changes, additions or deletions shall be made to the following document(s) as Indicated; all other conditions shall remain the same.

I. ADVERTISEMENT FOR BIDS

Item No.

- 1-1. Replace Text: Page 2, sentence beginning with “Bid Deadline...”
CHANGE to read as follows:

“Bid Deadline: Sealed Bids must be received on or before 2:30 P.M on
Wednesday, May 16, 2012.”

II. SUPPLEMENTARY INSTRUCTIONS TO BIDDERS

Item No.

- 2-1. Replace Text: Page 1, Item 4, CHANGE to read as follows:

Bids will be received on or before the Bid Deadline: 2:30PM, May16, 2012,
and only at:

Facilities Management, Bldg. 439
Door #E, Reception Counter
University of California, Santa Barbara
Santa Barbara, CA 93106-1030


III. DRAWINGS - ORTEGA DINING COMMONS

Item No.

- 3-1. Drawing No. E-001: Replace single line diagram on E-001 with single line
diagram shown below.

REFERENCE NOTES

- ② CONTRACTOR TO INSTALL (N) GENERAL ELECTRIC K FRAME BREAKER

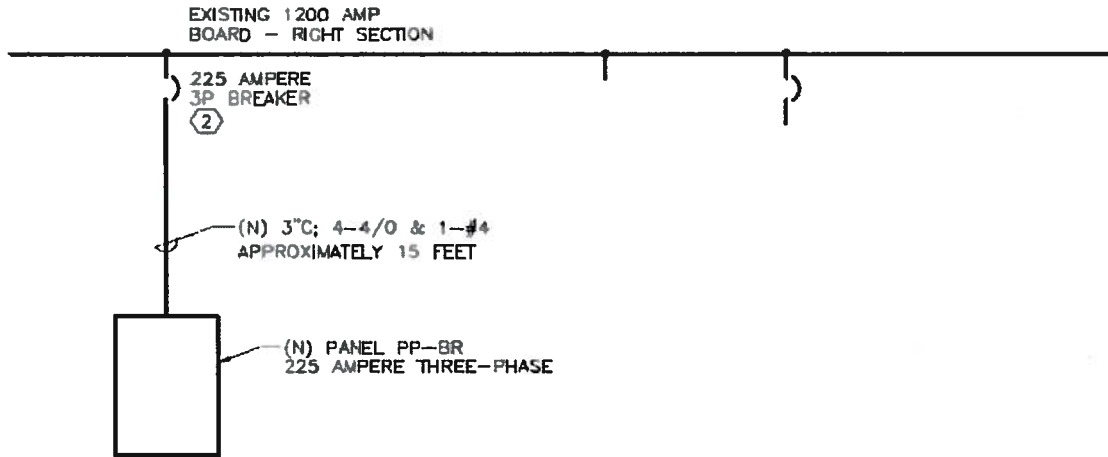

SINGLE LINE DIAGRAM

- 3-2. Drawing No. E-002: New and Demolition floor plans. Change "(E) Panel PP-BR to remain" to "(E) Panel PP-BR to be replaced with new".

END OF ADDENDUM NO. 4